




RTD EL-05-F

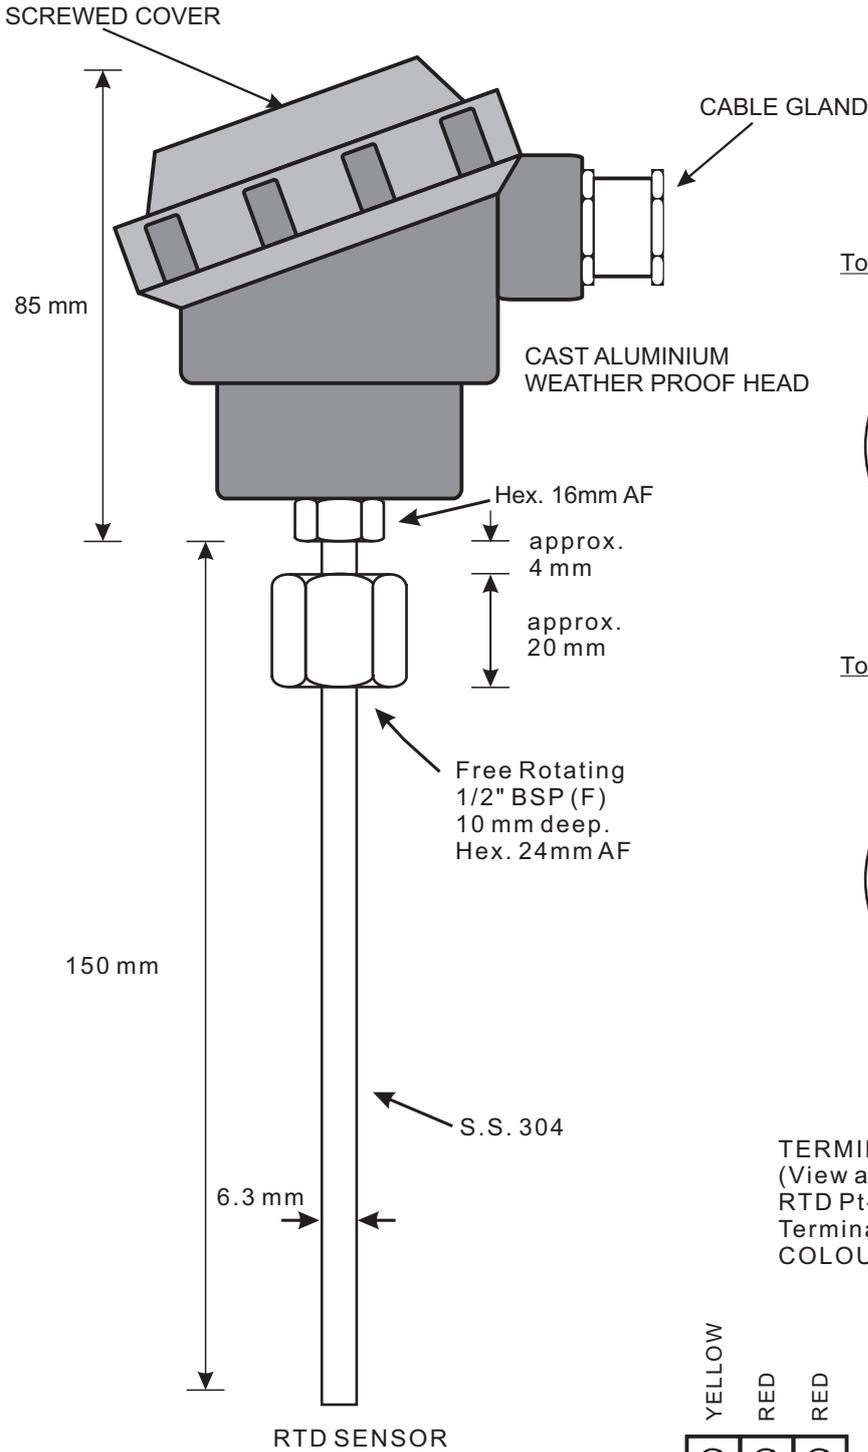


Top View for Terminal plate for RTD EL-05-FS

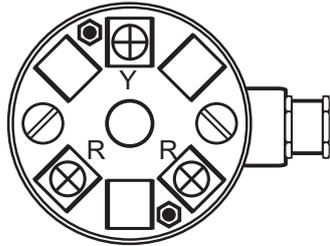

Top View for Terminal plate for RTD EL-05-FD

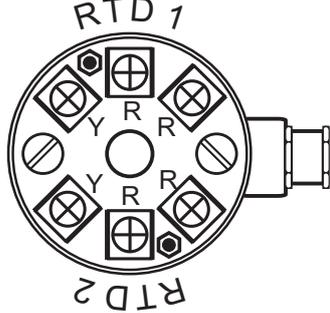

TERMINAL ARRANGMENT
(View after opening top cover)
RTD Pt-100 (IEC-751)
Terminals are identified by
COLOUR DOTS as shown below.

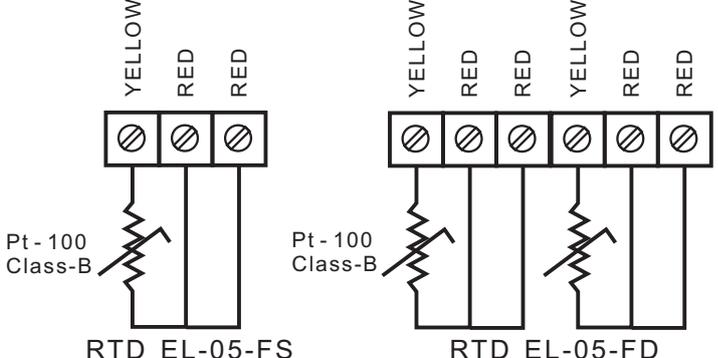

- Notes : 1) This RTD is to be installed on transformer using RTD pocket (Thermo-well).
2) Please make sure to keep at least 250mm clearance above the pocket to fit / replace the sensor.

 EMBELINK TECHNOLOGIES	Title		Details of RTD sensor type EL-05-FS & EL-05-FD.		
	Drwn. by		Drg. No.	EL20073105	
	Chk. by		Rev. No.	00	Rev. Date
					31st July, 2020